


TO MAINTAIN THE NEMA 4 AND 4X RATING OF THE VORTEX A/C WHEN MOUNTED TO THE SIDE OF AN ENCLOSURE, ORIENTATION MUST BE AS SHOWN BELOW. IF NEMA RATING IS UNIMPORTANT, THEN ORIENTATION IS ALSO UNIMPORTANT.

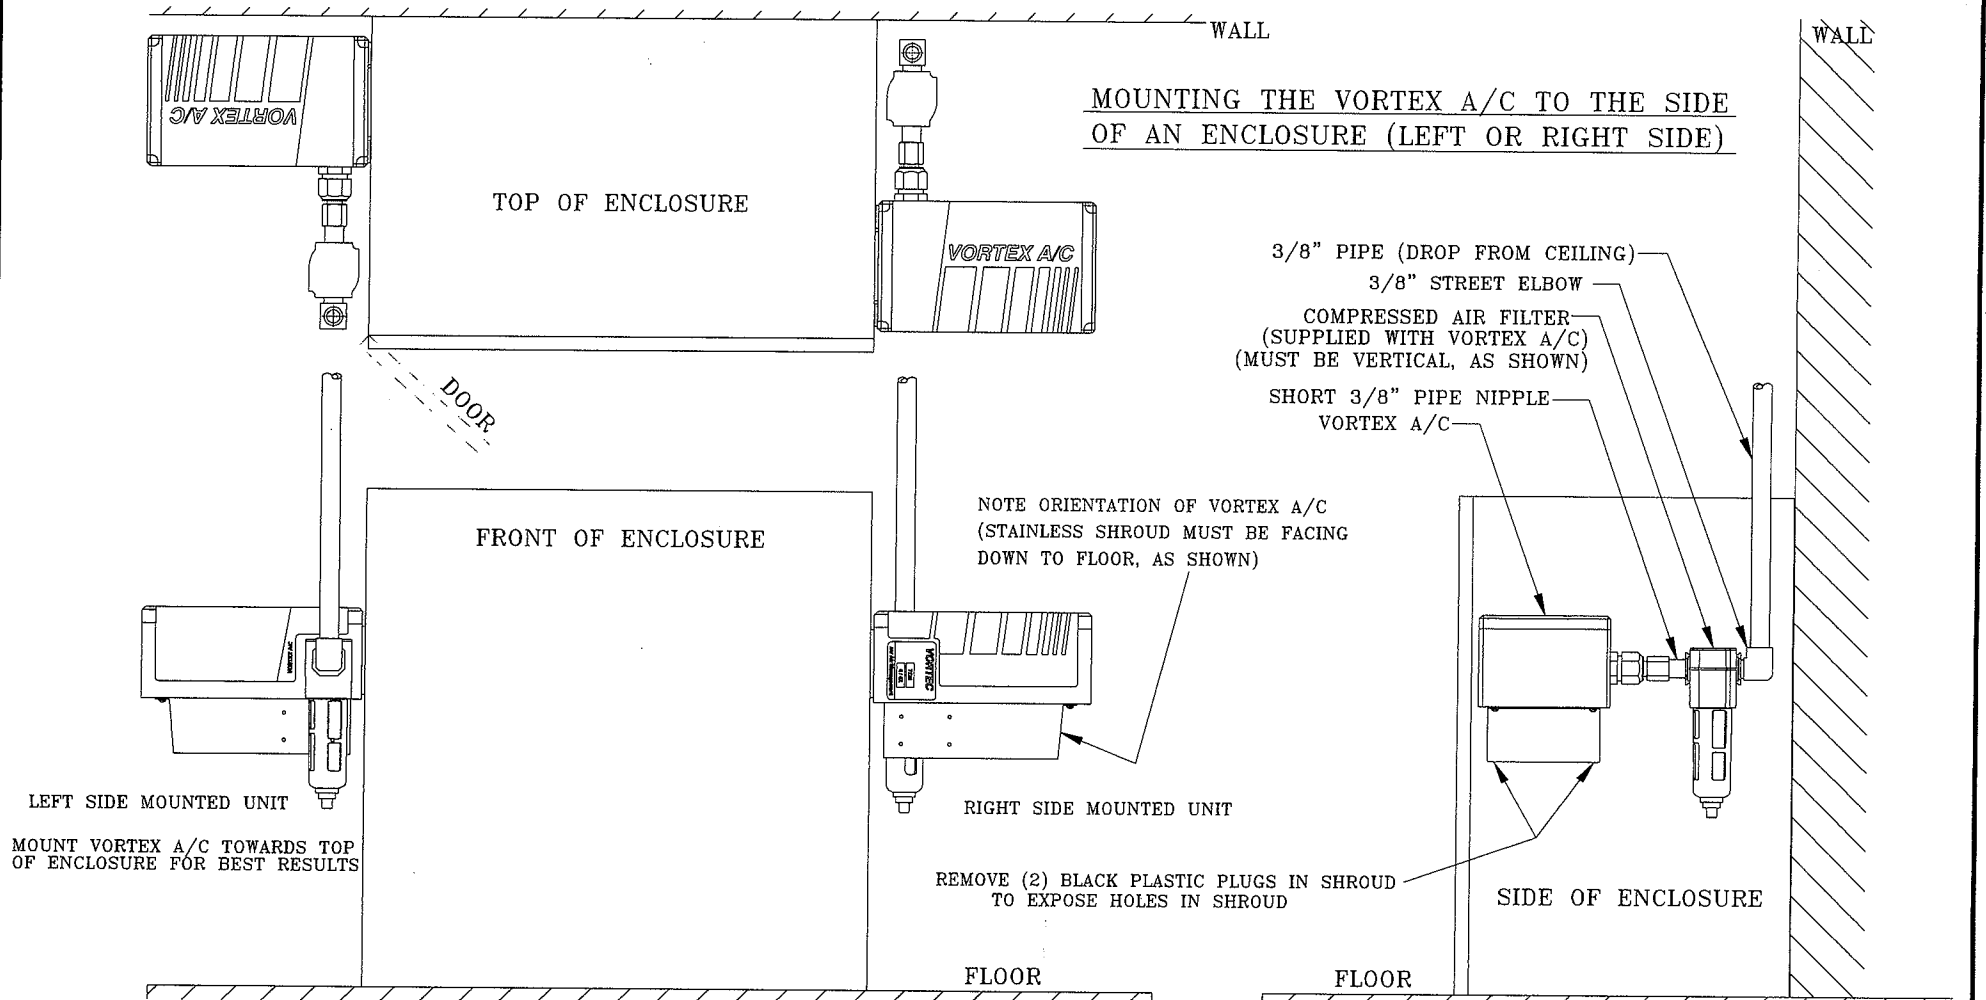

MOUNTING THE VORTEX A/C TO THE SIDE OF AN ENCLOSURE (LEFT OR RIGHT SIDE)

MOUNT VORTEX A/C TOWARDS TOP OF ENCLOSURE FOR BEST RESULTS

NOTE ORIENTATION OF VORTEX A/C (STAINLESS SHROUD MUST BE FACING DOWN TO FLOOR, AS SHOWN)

REMOVE (2) BLACK PLASTIC PLUGS IN SHROUD TO EXPOSE HOLES IN SHROUD

THE DESIGN CONTAINED IN THIS DRAWING WAS ORIGINATED BY AND IS THE EXCLUSIVE PROPERTY OF VORTEC CORPORATION. IT IS FURNISHED FOR CUSTOMER AND/OR MANUFACTURING INFORMATION ONLY AND IS NOT AN AUTHORIZATION OR LICENSE TO MAKE THIS CONSTRUCTION OR TO FURNISH THIS INFORMATION TO OTHERS.



ITW Vortec

ITW Vortec
An Illinois Tool Works Co.
10125 Corver Road
Cincinnati, Ohio 45242-9976

TOLERANCES

FRACTIONS ± 1/64
DECIMALS
XX ± .01
XXX ± .005
ANGLES ± 1°

TITLE

SIDE MOUNTED VORTEX A/C

DWG NO.

DATE
6/29/06

REV
A

SCALE

DRAWN BY SEB

SHEET 1 OF 1